

## **QUESTIONNAIRE FOR DOMESTIC WATER ESTIMATE**

Name: \_\_\_\_\_

Company: \_\_\_\_\_

Address: \_\_\_\_\_

Postcode: \_\_\_\_\_

Telephone: \_\_\_\_\_

Email: \_\_\_\_\_

The completed questionnaire will enable us to provide an estimate for the treatment system to suit your water supply. Please print out the pdf and complete, then fax to: 01422 377369 or scan and email to: [sales@prosep.co.uk](mailto:sales@prosep.co.uk). We can normally respond by return.

PROSEP FILTER SYSTEMS LTD  
Unit G19, River Bank Way  
Lowfields Business Park  
Elland, West Yorkshire  
HX5 9DN

**Tel: 01422 377367**  
Fax: 01422 377369

Email: [enquiries@prosep.co.uk](mailto:enquiries@prosep.co.uk)  
[www.prosep.co.uk](http://www.prosep.co.uk)

# PROSEP FILTER SYSTEMS LTD

## QUESTIONNAIRE FOR DOMESTIC WATER ESTIMATE

Q. Please state the problem you have with the existing water supply  
A.

Q. What is the source of the water  
A.

Q. Is the water when treated to supply just one dwelling  
A.

Q. Total number of bathrooms  
A

Q. Total number of people (include children) that will use the supply  
A.


Q. Is the hot water supply gravity fed or pressurised  
A.

Q. A backwashing system will require 1.5 times the normal flow to backwash. Is your water source able to maintain demand (Can you run an open hose for ½ an hour at a constant flow rate. Typically 25 – 35 litre/minute)  
A.

Q. Do you know your borehole pump make or model number  
A.

Q. Do you have a recent water analysis.  
A.

Q. From the layout options below, which most closely resembles your existing pipework layout.  
Draw any deviations on the layout.

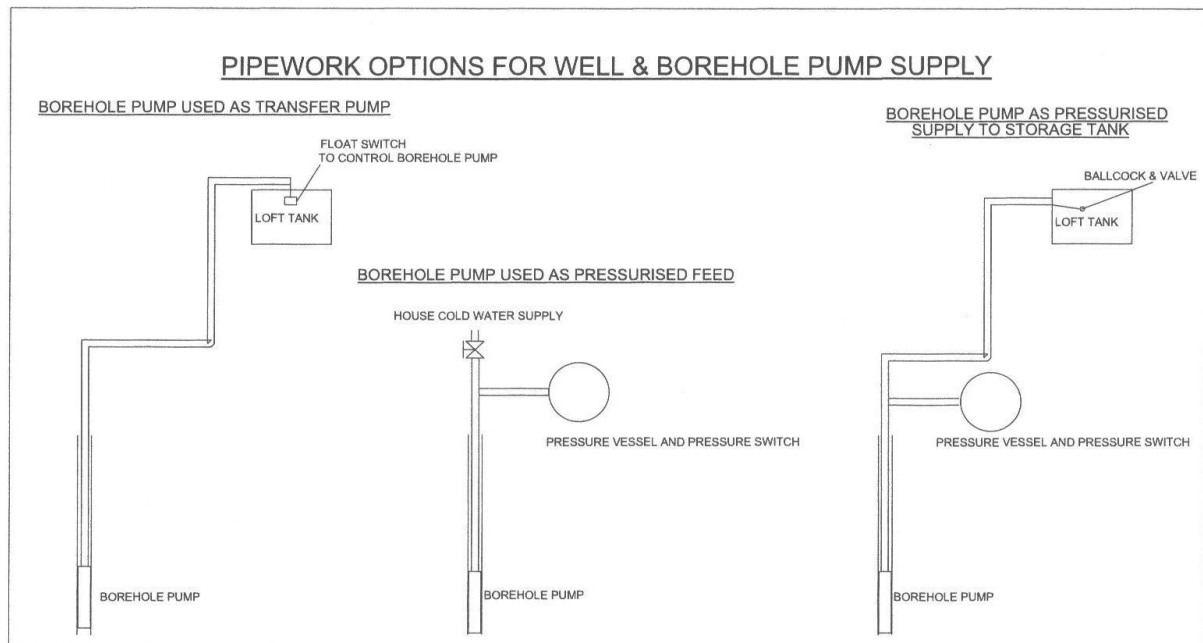

UNIT G19, RIVER BANK WAY, LOWFIELDS BUSINESS PARK,  
ELLAND, WEST YORKSHIRE HX5 9DN  
TEL: 01422 377367 FAX: 01422 377369  
Email: sales@prosep.co.uk Web: www.prosep.co.uk