

Marine 800 Series

Marine 800 Series

Racor Marine 800 Series recyclers offer large diesel engine operators both ease of maintenance and continuous engine operation. Continuous operations include filter change-outs and the draining of accumulated water from the handy drain valve. Manifold systems have sufficient fuel flow for prime or standby power operations, commercial marine engines, or other large engine applications.

This recycling series includes the 812MA, the dual manifolded 75812MA and the triple manifolded 79812MA. The Marine 800 Series is designed to filter water and solid contaminants from diesel fuel.

These assemblies utilize proven Racor technology with Aquabloc^{II} filtration, which filters down to 40 micron, to purify diesel fuel before OEM engine filters are used. Protecting high tolerance injection components keeps engines running at peak performance and lowers maintenance costs. Large inlet and outlet ports allow for improved flow and less fuel flow restriction.

Features and options may include clear contaminant collection bowls; but not marine units, water sight glasses, manual drains and vacuum or compound gauges the marine units are powder coated white.

Determine the fuel flow rate

Selection should be made by considering the primary use for the unit. Recycling/filtering the fuel in storage tanks cleans the fuel while removing particulates and sediment accumulations. The fuel may be recycled numerous times, depending on the severity of contamination. Filter/recycling clock times can be reduced by selecting a larger capacity unit. Severely contaminated tanks may require more than one "cycle" to clean them properly.

For example, the 812MA filters up to 720 gallons per hour or 12 gallons per minute. It would take about 8.5 minutes to filter 100 gallons. To cycle the tank 3 times would take about 26 minutes. One cycle of 100 gallons of fuel with a 75812MA would take approximately 4 minutes.



812MA



75812MA



79812MA

Marine 800 Series Overview



Specifications	812MA	75812MA	79812MA
Maximum Flow Rate (one unit online) (two units online) (three units online)	720 GPH (2725 LPH) N/A N/A	720 GPH (2725 LPH) 1440 GPH (5450 LPH) N/A	720 GPH (2725 LPH) 1440 GPH (5450 LPH) 2160 GPH (8175 LPH)
Port Size	1" NPT	1" NPT	1" NPT
Replacement Elements	RK22610	RK22610 ¹	RK22610 ¹
Micron Rating nominal): (upper element) (lower element)	40 Coalescer	40 Coalescer	40 Coalescer
Height	33.2 in. (84.3 cm)	33.2 in. (84.3 cm)	33.2 in. (84.3 cm)
Width	6.6 in. (16.8 cm)	21.8 in. (55.4 cm)	33.3 in. (84.6 cm)
Depth	8.8 in. (22.4 cm)	16.0 in. (40.6 cm)	16.0 in. (40.6 cm)
Weight (dry)	36.0 lb (16.3 kg)	89.0 lb (40.4 kg)	133.0 lb (60.4 kg)
Min. Service Clearance: (above assembly) (below assembly)	12.0 in. (30.5 cm) 4.0 in. (10.2 cm)	12.0 in. (30.5 cm) 4.0 in. (10.2 cm)	12.0 in. (30.5 cm) 4.0 in. (10.2 cm)
Max. Working Pressure	30 PSI (2.07 bar)	30 PSI (2.07 bar)	30 PSI (2.07 bar)
Differential Pressure	3.2 PSI (0.22 bar)	3.3 PSI (0.23 bar)	6.0 PSI (0.41 bar)
H₂O Removal Efficiency	99%	99%	99%
Operating Temperature	-10° to +180°F (-23° to +80°C)		

¹ 75812MA assemblies require two RK22610 element kits and the 79812MA requires three.

Marine 800 Series

Installation Instructions

Before installing the filter assembly:

- Obtain good ventilation and lighting.
- Maintain a safe working environment.
- The engine must be off for installation.
- DO NOT smoke or allow open flames near the installation.

When positioning the filter assembly:


- Filter assemblies should be installed on vacuum side of fuel transfer pump for optimum water separating efficiency. See Installation Diagram.
- Keep fuel line restrictions to a minimum. Locate filter assembly between horizontal planes of bottom of fuel tank and inlet of fuel pump, if possible. If filter assembly is installed in an application where

fuel tank is higher than filter, a shut-off valve must be installed between tank and filter assembly INLET. This will be used when servicing replacement elements.

Installing the filter assembly:

- Install the unit in a location which provides accessibility and protection from heat, flames, or accidental impacts. Always adhere to applicable local piping regulations or codes. Use the maximum line size possible and avoid reducers and elbows in order to keep restriction values as low as possible.
- Apply thread sealant (do not use thread tapes) to inlet and outlet fittings prior to installing onto filter assembly.
- When routing hose, avoid surfaces that move, have sharp edges, or get hot (such as exhaust piping).

Mounting Information

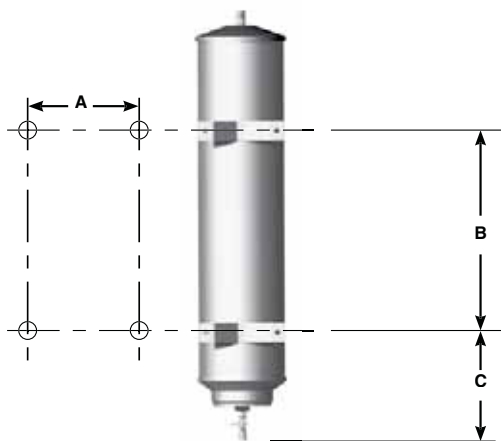

A:

812MA: 5.5 in. (13.8 cm)
 75812MA: 20.3 in. (51.4 cm)
 79812MA: 31.8 in. (80.8 cm)

B:

812MA: 15.5 in. (39.2 cm)
 75812MA: 15.5 in. (39.2 cm)
 79812MA: 16.0 in. (40.6 cm)

C:

812MA: 8.3 in. (21.0 cm)
 75812MA: 8.6 in. (21.8 cm)
 79812MA: 8.1 in. (20.6 cm)

Priming Instructions

1. Close inlet fuel valve, if applicable.
2. Remove T-handle(s) and lid(s) from top of filter assembly.
3. Fill filter assembly with clean fuel.
4. Lubricate lid gasket(s) and T-handle O-ring(s) with clean fuel or motor oil.
5. Replace lid(s) and T-handle(s) and tighten snugly by hand only - do not use tools.
6. Open inlet fuel valve, if applicable.
7. Start engine and check for leaks. Correct as necessary with engine off.

Draining Water

Drain water and contaminants by opening the self-venting drain. If more than 1.4 oz (40 ml) of fluid is drained, follow priming instructions above. Otherwise, start engine and allow air to purge from system prior to operating equipment at normal loads.

Element Replacement

Frequency of element replacement is determined by the contamination level in fuel. Recommended service intervals are as follows: every 10,000 miles, 500 hours, every other oil change, annually, or at the first indication of power loss, whichever comes first.

Foul smelling fuel is an indication of microbiological contamination. A change of fuel source and Racor fuel additives are recommended. Always carry extra replacement elements as one tankful of excessively dirty fuel can plug a filter quickly.

1. Close inlet fuel valve, if applicable, and completely drain filter assembly.
2. Remove T-handle(s), lid(s) and lid gasket(s).
3. Remove elements from inside housing(s) and dispose properly.
4. Lubricate new element(s) seals with clean fuel or motor oil and insert coalescer element(s) first, then the 40 micron paper element(s).

Insert new elements SLOWLY with a slight twisting motion. Inserting them too quickly may dislodge element seals.

5. Install new lid gasket(s), supplied with new elements, into lid groove.
6. Follow priming instructions above.

Recycling Filtering

Recycling or filtering fuel in storage tanks cleans the fuel while removing particulates and sediment accumulations. Fuel should be recycled numerous times, depending on the severity of contamination. Filter/recycling clock times can be reduced by selecting a larger capacity unit.

Severely contaminated fuel may require several cleaning cycles to clean the fuel properly. Cycle time (the amount of time it takes to clean an entire tank of fuel one time) can be reduced by installing a duplex (75812MA) or triplex (79812MA) recycling system. For example, the 812MA recycler filters up to 720 gallons per hour (GPH) or 12 gallons per minute. The cycle time for a 100 gallon tank of fuel would be about 8.3 minutes. Depending of the contamination level of the fuel, one cycle may be enough to clean the fuel properly. If the fuel requires additional cleaning (more cycles), cleaning the fuel can become time consuming, especially if your filtering tanks larger than 100 gallons. By installing a 75812MA (maximum flow rate is 1440 GPH), the same 100 gallons of fuel can be clean in a little over 4 minutes (one cycle); a 79812MA would cut the cycle time down to around 3 minutes. If time is the issue, installing a duplex or triplex recycling system is the answer.



01422 377367



enquiries@prosep.co.uk

PROSEP
FILTER SYSTEMS LTD

WE ARE YOUR **'ONE STOP SHOP'** FOR ALL
OF YOUR FILTRATION REQUIREMENTS

LIQUID FILTRATION

- CARTRIDGES
- FILTER BAGS
- VESSELS
- STRAINERS

AIR FILTRATION

- VENT FILTERS
- STERILE AIR
- VACCUM
- AIR-CONDITIONING
- FILTER MEDIA

DOMESTIC

- ULTRAVIOLET
- TREATMENT OF BOREHOLES,
SPRINGS & WELLS
- WATER TESTING

FUEL FILTRATION

- DIESEL, AVIATION



Prosep Filter Systems Ltd
Unit G19, River Bank Way,
Lowfields Business Park,
Elland, West Yorkshire
HX5 9DN

Phone: 01422 377367
email: sales@prosep.co.uk
www.prosep.co.uk



for all your filter requirements